


INSTALLATION INSTRUCTIONS MOULDED CASE CIRCUIT BREAKERS TEMBREAK PRO P400 4P THERMAL MAGNETIC

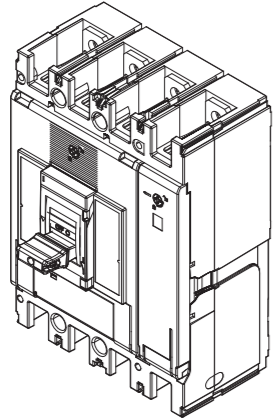

NHP Electrical Engineering Products Pty Ltd
A.B.N. 84 004 304 812
AUS 1300 NHP NHP | nhp.com.au
NZ 0800 NHP NHP | nhp-nz.com

TOOLS REQUIRED (NOT included)

- T1 Screwdriver Flathead (5mm)
- T2 Screwdriver Phillips (#2)
- T3 19mm Socket wrench
- T4 8mm Allen key Socket wrench
- T5 19mm Ring Spanner

HARDWARE (included)

- A M10x30 Socket Screw (8 qty)
- B M10 spring washer (8 qty)
- C M10 flat washer (8 qty)
- D M6x100 mounting screws (4 qty)
- E Interpole Barriers (3 qty)
- Instruction Manual (This Document)






HARDWARE (NOT included)

- F Cable Lug or Copper Bar
- G *M12x35 hex bolt (8 qty)
- H *M12 flat washer (8 qty)
- I *M12 Belleville washer (8 qty)
- J *M12 nut (8 qty)

*For extension bar connection only

OPTIONAL (NOT included)

- K Extension Bars
- L Terminal Covers
- M Terminal Cover Lock
- N Handle Lock
- Internal Accessories

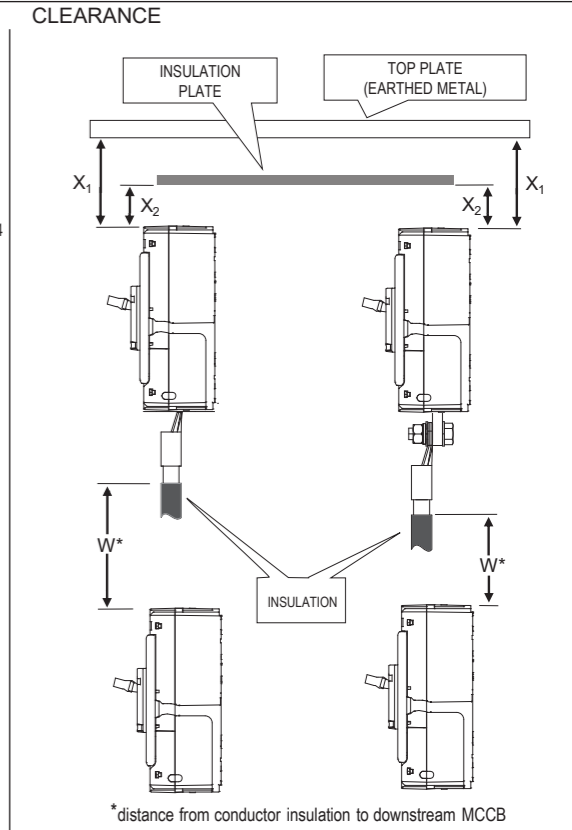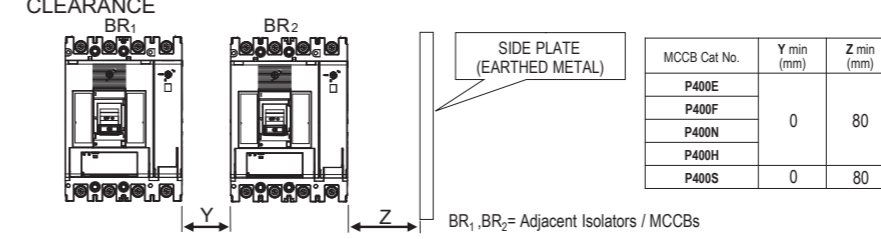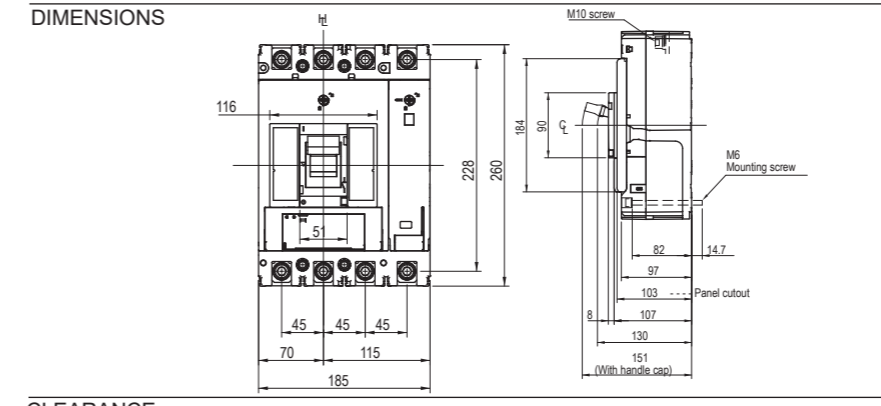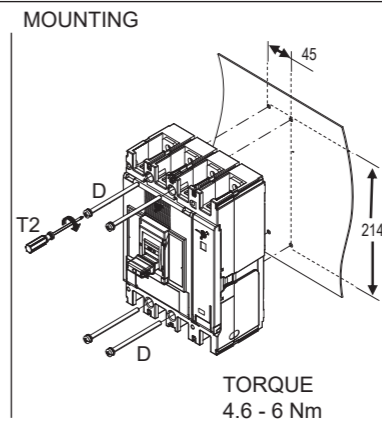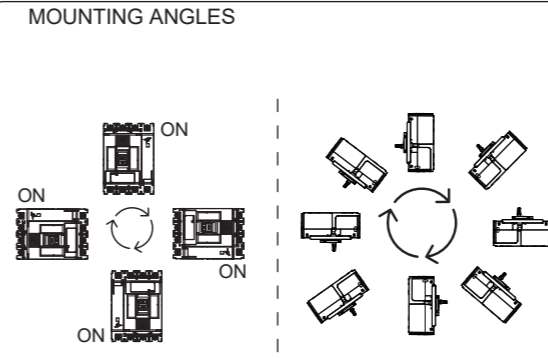


*distance from conductor insulation to downstream MCCB

MCCB Cat No.	W* min (mm)	X ₁ min (mm)	X ₂ min (mm)
P400E	100	80	60
P400F	100	80	60
P400N	100	80	60
P400H	120	120	80
P400S	120	120	80

OPERATING INSTRUCTIONS

Operation	Force (Nm)
OFF → ON	150
ON → OFF	130
TRIP → OFF	162

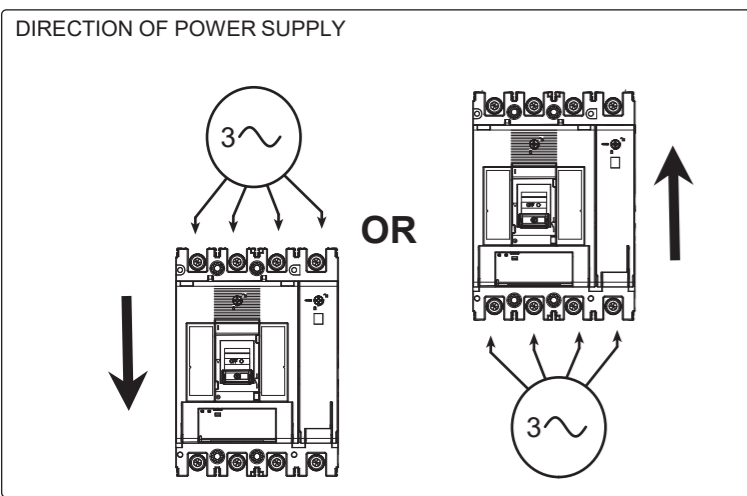

INTERNAL ACCESSORIES ASSEMBLY PROCEDURE*

STEP 1 TRIP MCCB

STEP 2 OPEN COVER

STEP 3 IDENTIFY TRIP BAR & MECHANISM

STEP 4.1 UVT/SHUNT INSTALLATION



STEP 4.2 ALARM INSTALLATION

STEP 5 CLOSE MCCB COVER


*For additional internal accessory installations, scan QR code and refer to user manual for more details

CONDUCTOR CONNECTION PROCEDURE -- FRONT CONNECTION -- EXTENSION BAR CONNECTION PROCEDURE


A	M10x30 Socket screw	H	M12 Flat washer
B	M10 Spring washer	I	M12 Belleville washer
C	M10 Flat washer	J	M12 Nut
F	Lugs or copper bar	K	Extension Bars
G	M12x35 hex bolt		

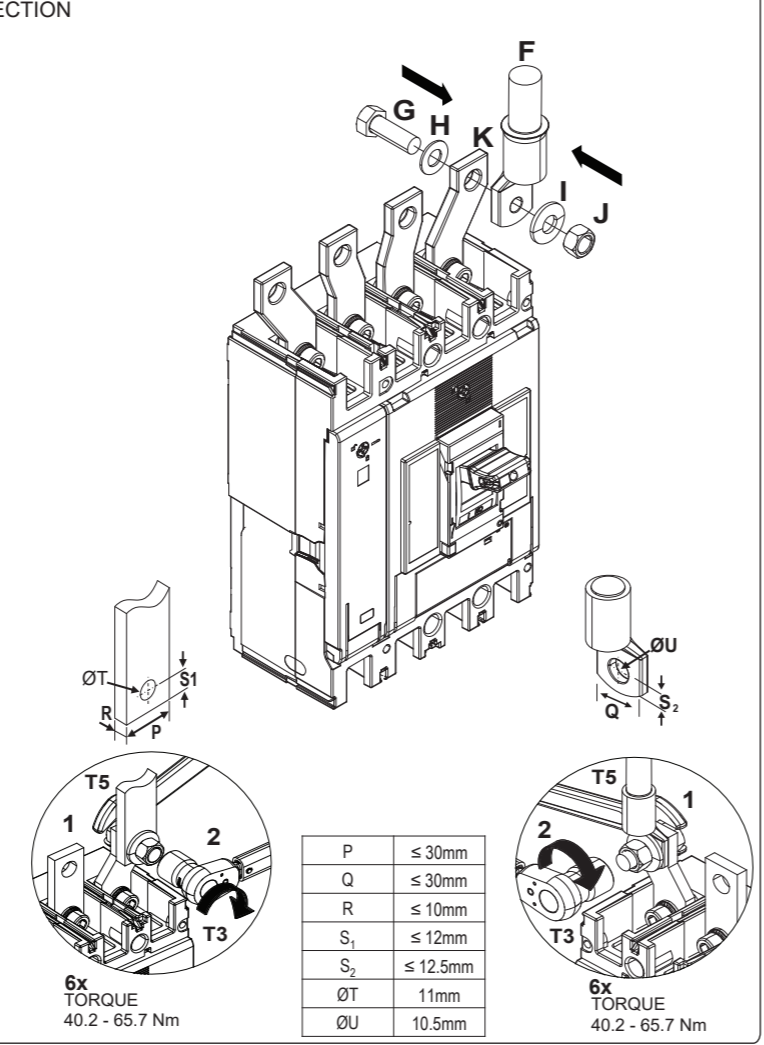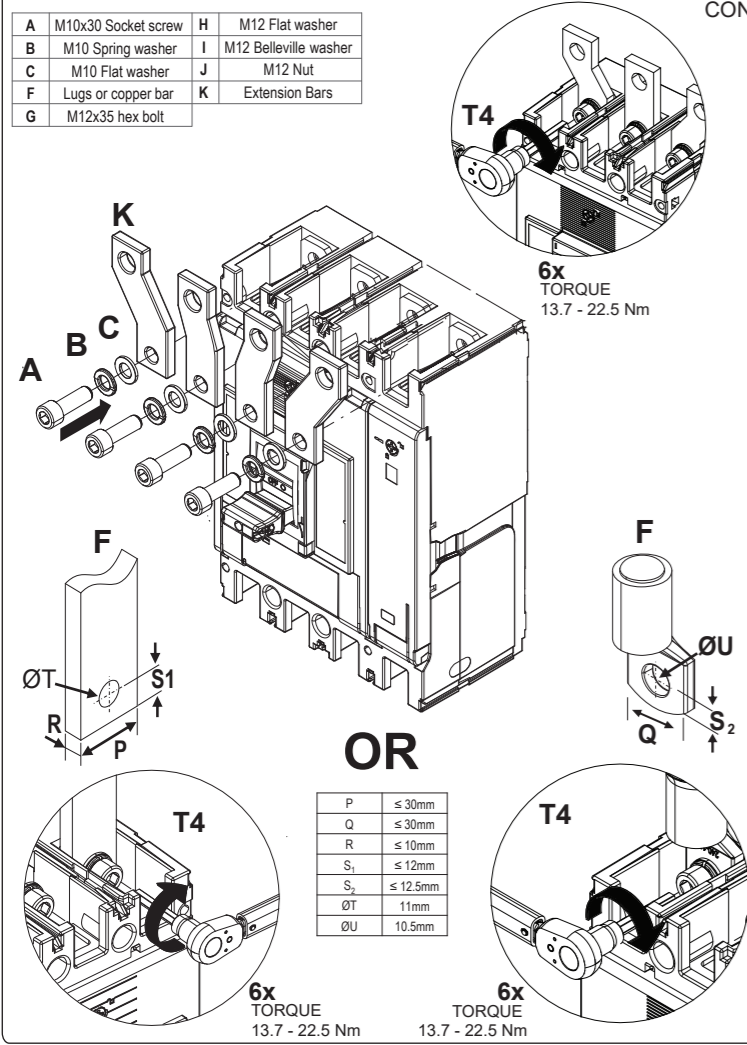


TOPSIDE INSULATION RECOMMENDATIONS - 415 / 440V AC

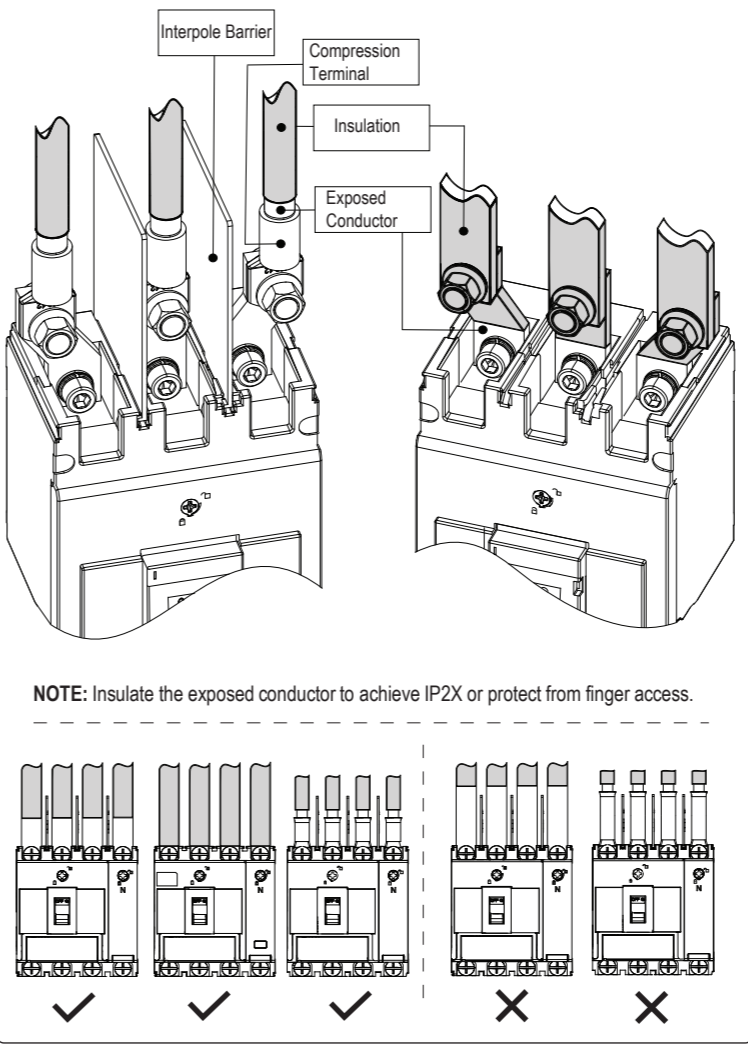


TRIP UNIT ADJUSTMENT PROCEDURE

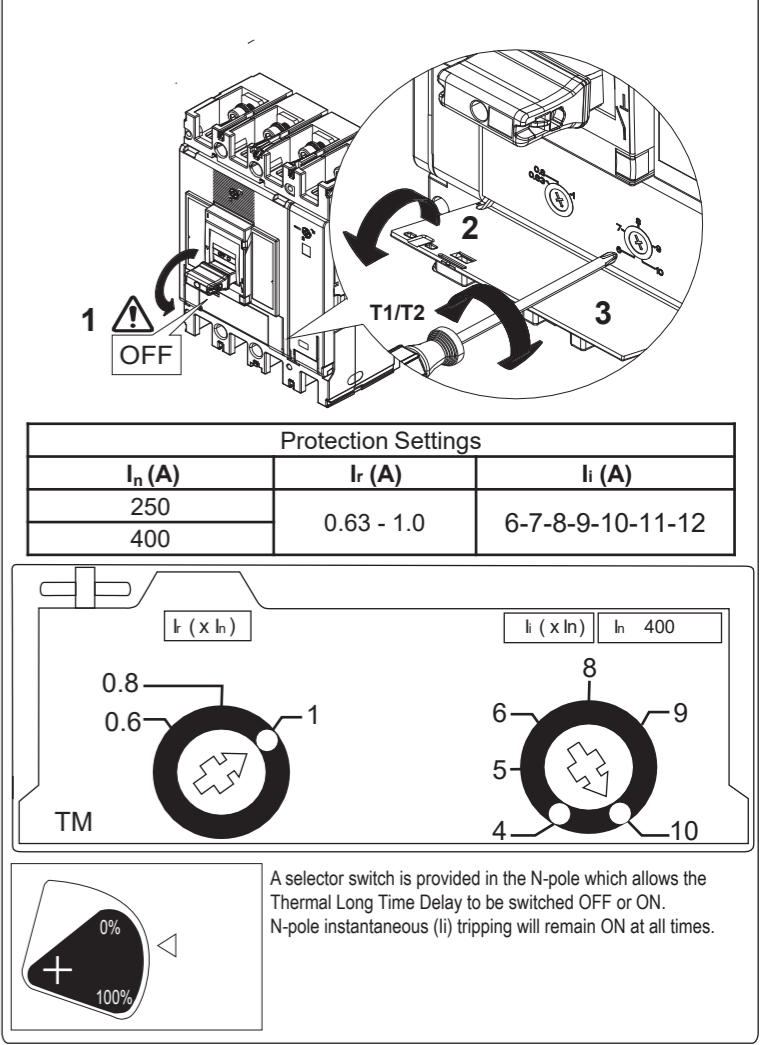


TERMINAL COVER MOUNTING PROCEDURE

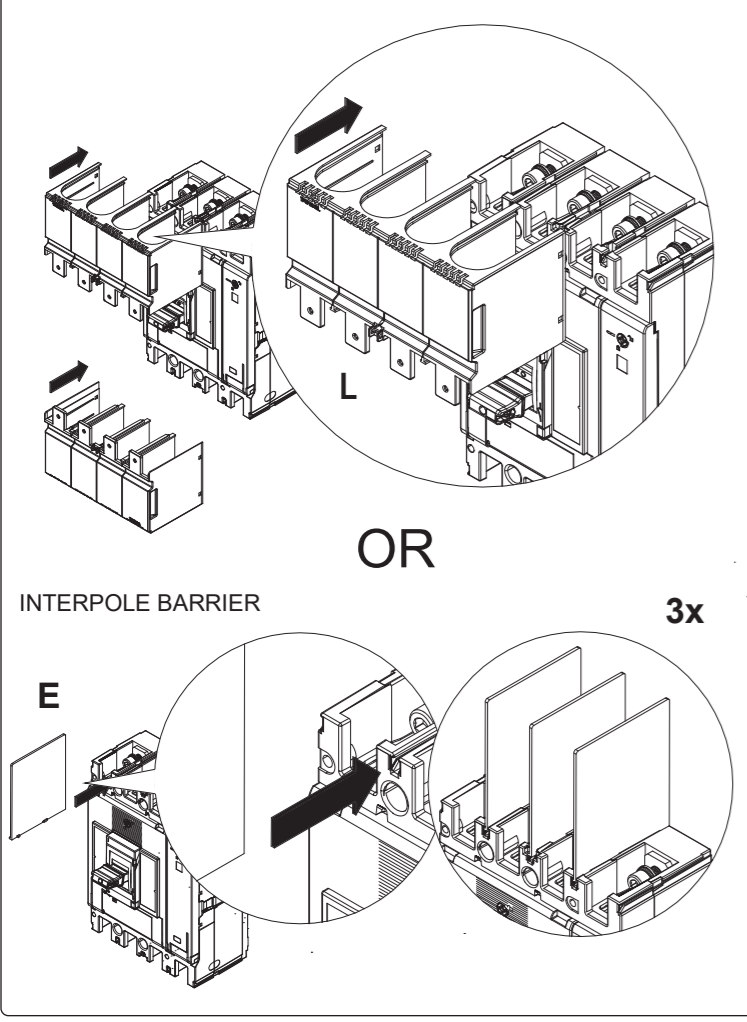


TERMINAL COVER LOCK

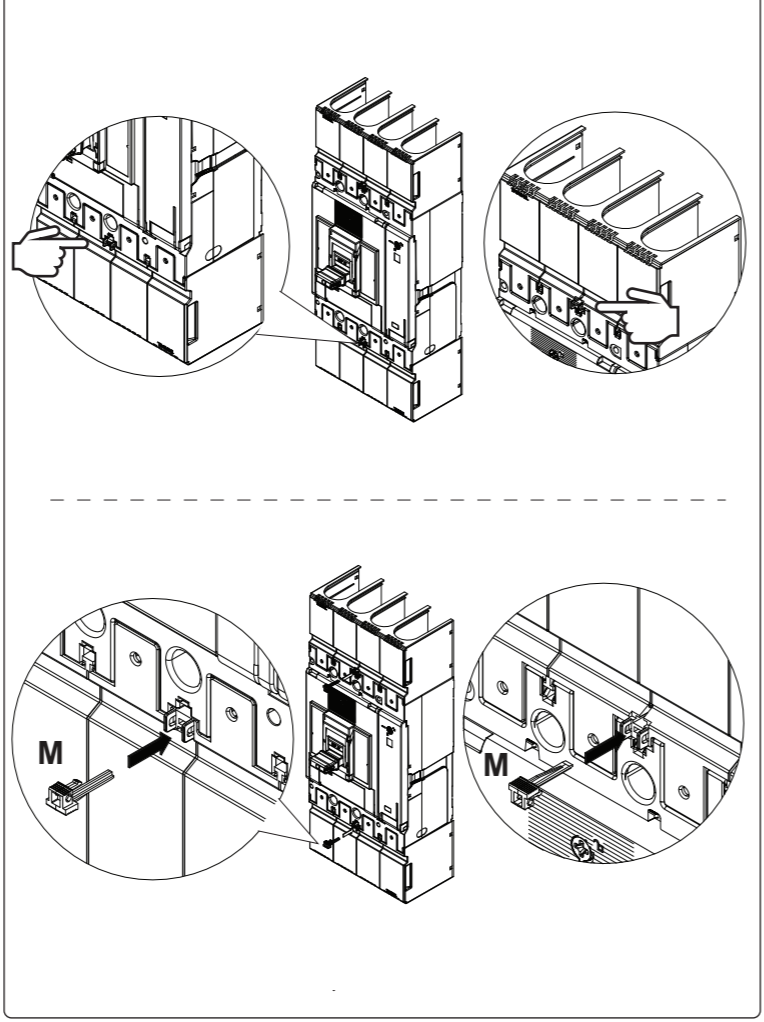

TOGGLE LOCK / PADLOCK ASSEMBLY PROCEDURE

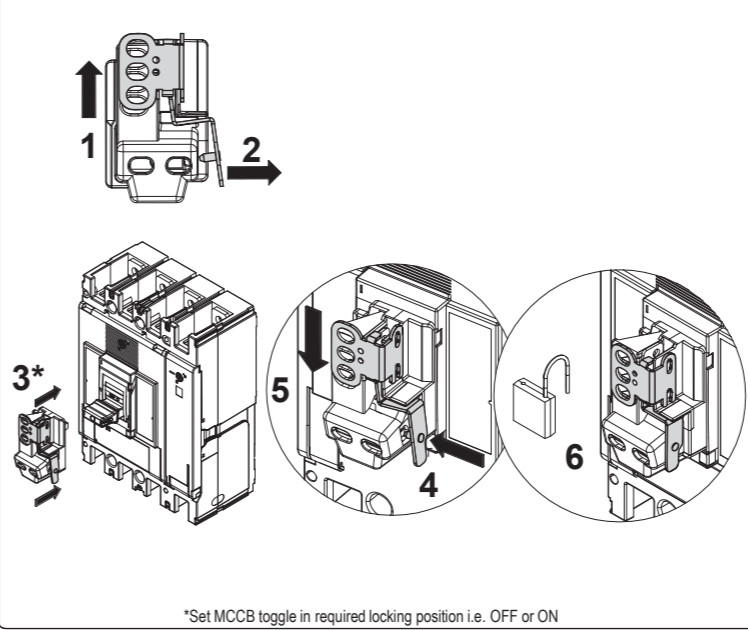

TOGGLE LOCK OPTION

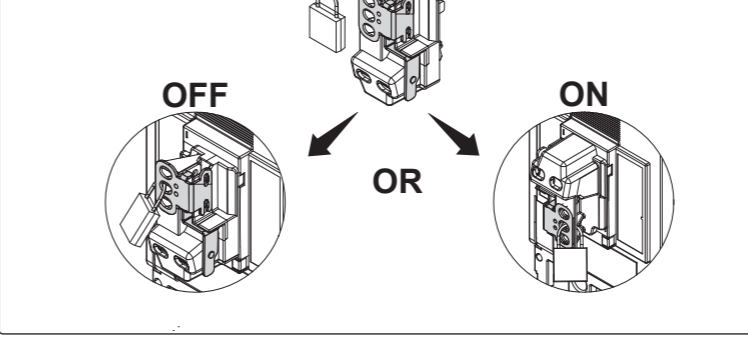

TIME CURRENT CHARACTERISTIC CURVE

